



INSTALLATION INSTRUCTIONS

“CHE2” Electric Heater Kits

for use in Air Handlers

ATTENTION INSTALLING PERSONNEL

Prior to installation, thoroughly familiarize yourself with this installation Manual. Observe all safety warnings. During installation or repair, caution is to be observed. It is your responsibility to install the product safely and to educate the customer on its safe use.

Eair LLC
12201 N.W107th Avenue, Medley, FL33178
www.comfortstarusa.com




CAUTIONS


- **ENSURE THAT ALL POWER IS DICONNECTED PRIOR TO ATTEMPTING INSTALLATION OF THIS HEATER KIT. THERE MAY BE MORE THAN ONE DISCONNECT SERVICING THE UNIT.**
- **A MEANS OF STRAIN RELIEF AND CONDUCTOR PROTECTION MUST BE PROVIDED AT THE SUPPLY WIRE ENTRANCE INTO CABINET.**
- **USE COPPER CONDUCTORS ONLY.**
- **INSTALLATION MUST FOLLOW NATIONAL ELECTRIC CODE AND OTHER APPLICABLE CODES.**

IF THIS APPLIANCE IS INSTALLED IN AN ENCLOSED AREA SUCH AS A GARAGE OR UTILITY ROOM WITH ANY CARBON MONOXIDE PRODUCING APPLIANCE, ENSURE THE AREA IS PROPERLY VENTILATED.


1.Remove the upper access panel from the air handler.

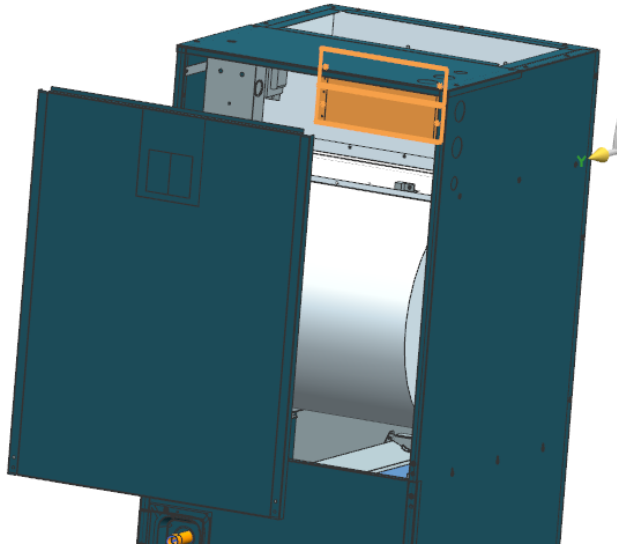


2. Remove the cover plate from the air handler.

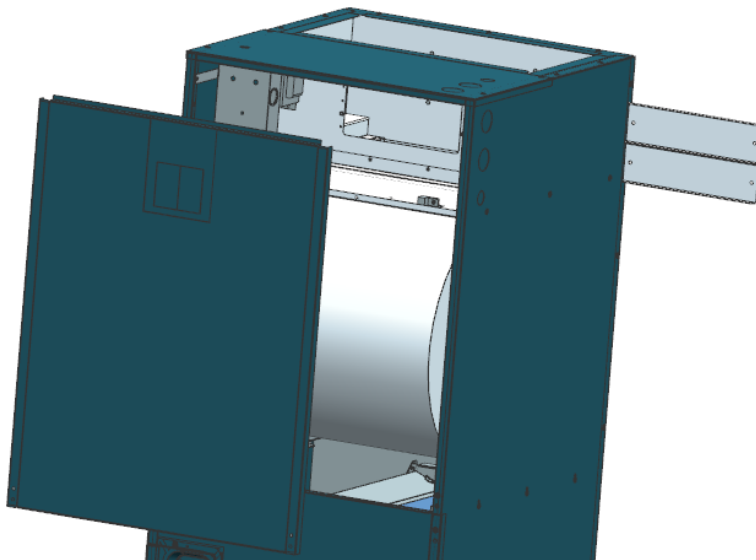


3. Slide the heater kit into the slot and secure element plate with previously removed screws.

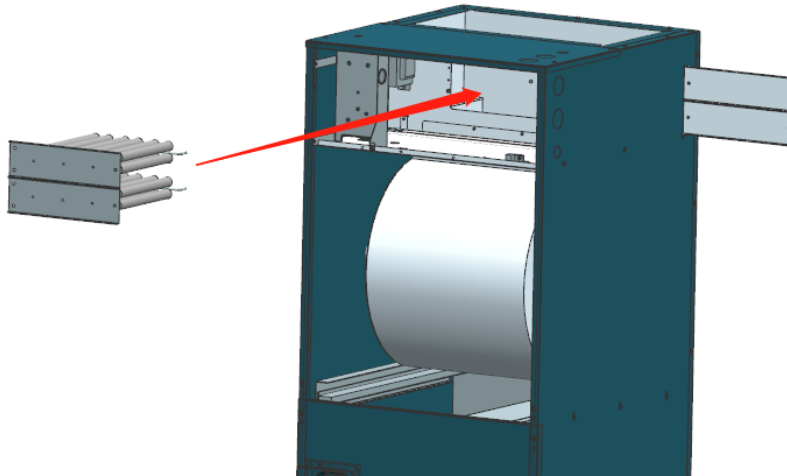


4. The heater installation completed.

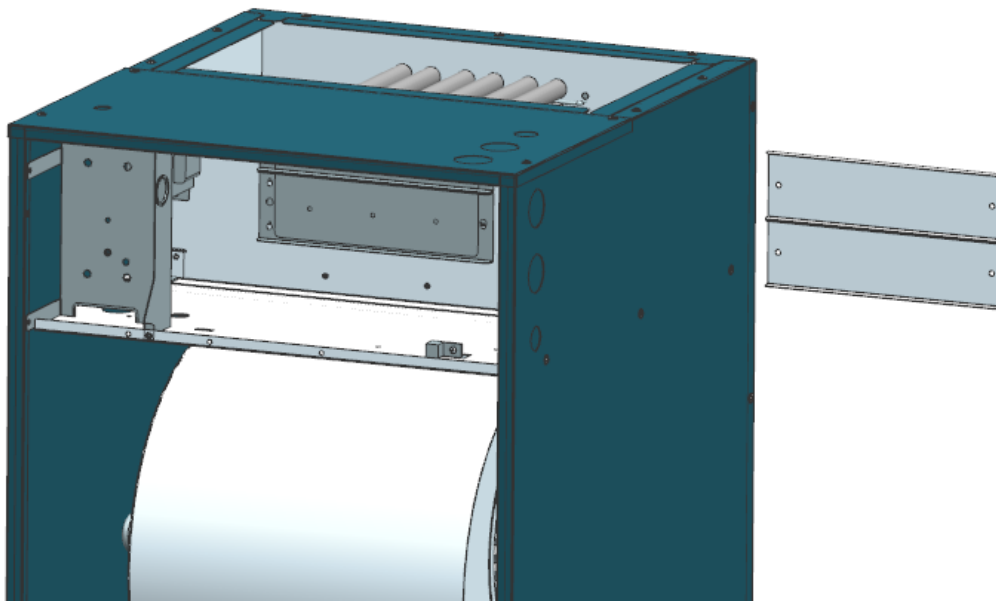

5.fitted the attachment clip and the hole and fasten.

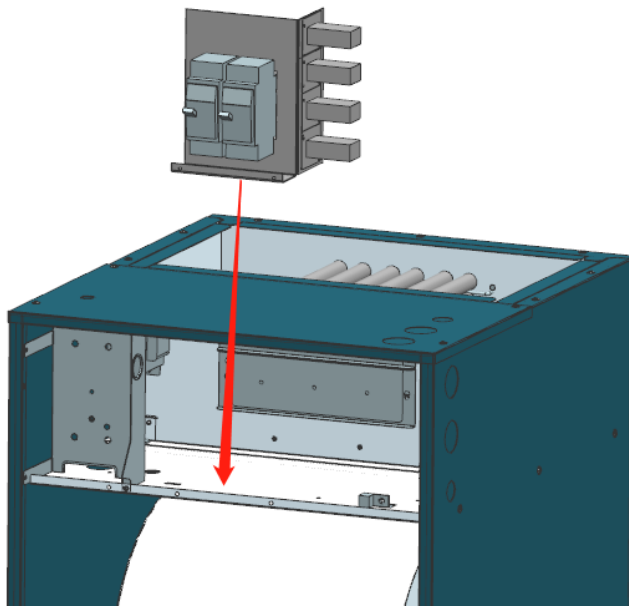

6. The breaker installation completed.

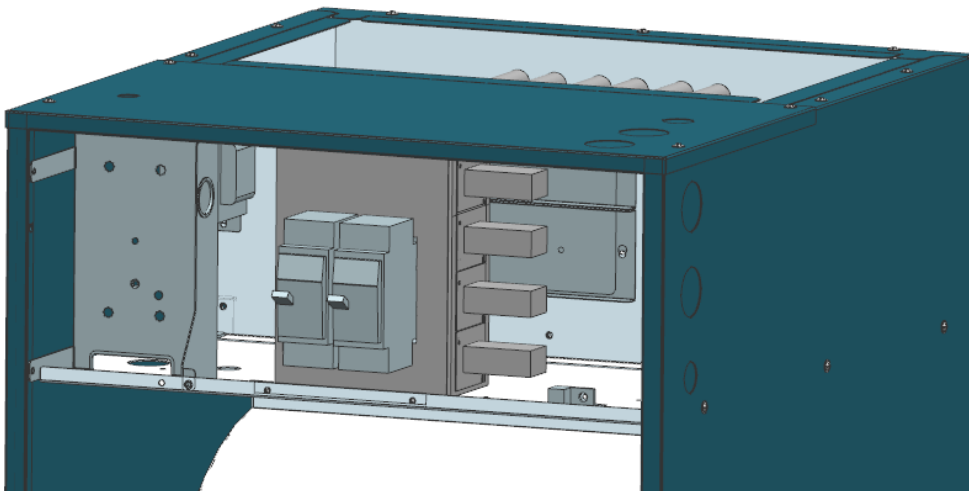

7. break out appropriate area of the plastic circuit breaker cover on the access panel of the air handler.

